


THE ANCHOR BOLTS AND CONDUITS SHALL NOT BE PROJECTED MORE 4 INCHES ABOVE A GROUND LINE BETWEEN THE STRADDLING WHEELS OF A VEHICLE.

**BREAKAWAY SUPPORT STUB HEIGHT MEASUREMENT**

DUCTED CABLE INSTALLED THROUGH 3" CONDUIT CROSSINGS TO LUMINAIRE POLE BASE: INSTALL DUCTED CABLE INTO THE POLE BASE. THE DUCT SHOULD BE EXTENDED 1" ABOVE THE CONDUIT. THE CONDUIT SWEEP SHOULD BE INSTALLED ACCORDING TO THE MANUFACTURER OF THE DUCTED CABLE TO PREVENT THE DUCTED CABLE FROM CRIMPING. IF DUCTED CABLE INSTALLED BETWEEN POLE BASES: INSTALL RIGID STEEL/DUCTED CABLE COUPLING. USE BONDOUT CONDUIT ADHESIVE OR APPROVED EQUAL TO CONNECT THE RIGID STEEL TO DUCTED CABLE. RACEWAYS SHALL BE THE SAME SIZE AS THE DUCTED CABLE WHICH ATTACHES TO THE RIGID STEEL CONDUIT. ALTERNATELY IF DUCTED CABLE IS USED, THE CONTRACTOR CAN INSTALL RIGID STEEL CONDUIT TWO TIMES THE SIZE OF THE DUCT AND RUN THE SWEEP FOR THE CONDUIT SHALL BE INCREASED TO ADHERE TO THE BENDING RADIUS RECOMMENDED BY THE MANUFACTURER OF THE DUCT.


3/4" SCHEDULE 80 PVC CONDUIT (WITH BUSHING) FOR GROUND WIRE (EACH BASE) AND SHALL BE A MIN OF 24" FROM THE EDGE OF THE POLE BASE.

**GROUNDING DETAIL**

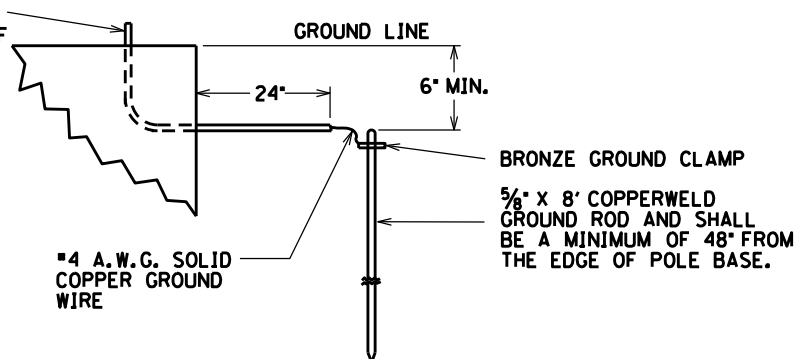

SPECIAL NOTE FOR THE TRANSFORMER BASE: FUSED CONNECTOR KITS SHALL BE INSTALLED FOR ALL 120 VOLT WIRING IN TRANSFORMER BASES. THIS WILL ONLY BE NEEDED FOR PEDESTRAIN HEADS AND SIGNALS HEADS. PEDESTRAIN DETECTORS DO NOT REQUIRE FUSED CONNECTOR KITS. CONTRACTOR CAN USE ONE KIT FOR A COMMON NEUTRAL FOR ALL DEVICES IN THE TRANSFORMER BASE. THERE SHALL BE A METAL LUG INSTALLED IN THE NEUTRAL WIRE KIT INSTEAD OF A FUSE.


**BREAKAWAY FUSE CONNECTOR KIT**

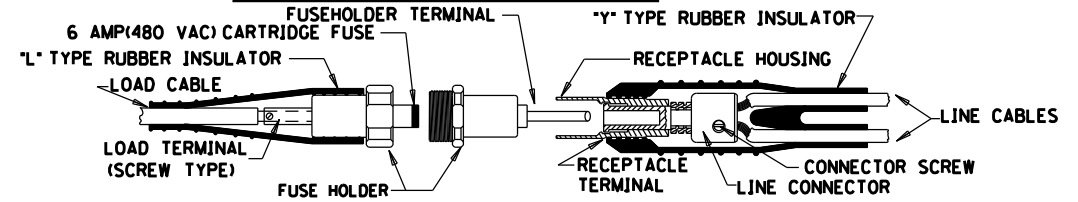

**DETAILS OF TYPE HEB-JW-RYC CONNECTOR**



**TYPE HEB-JW-RYC CONNECTOR SHOWN**

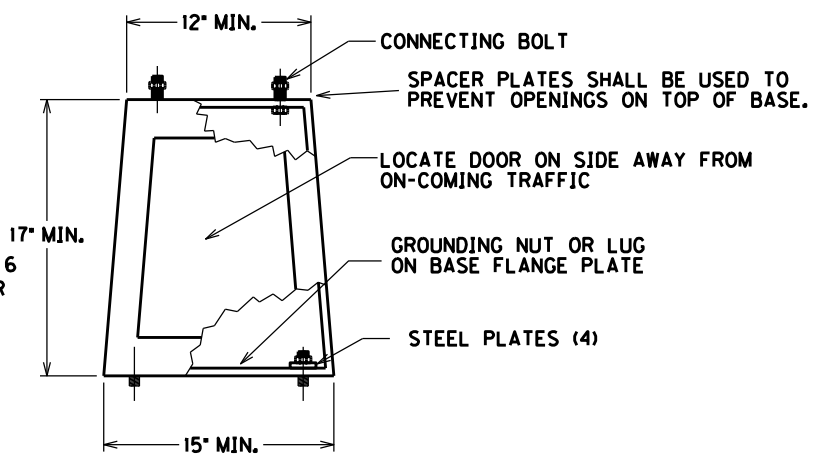


CONCRETE BASES SHALL BE POURED LEVEL. NO MORE THAN A 3/8" GAP SHALL EXIST BETWEEN CONCRETE BASE AND TRANSFORMER BASE WHEN THE POLE IS PLUMBED.

**SIGNAL LUMINAIRE**

**CAST ALUMINUM TRANSFORMER BASE**

NOTE: THE TRANSFORMER BASE DOOR SHALL HAVE A 4" BY 6" SHOCK HAZARD WARNING STICKER INSTALLED 3" FROM THE TOP OF THE DOOR. THE STICKER SHALL BE METALCRAFT PLY695 PREM STYLEMARK LABEL WITH .007 THICKNESS, WITH UV WHITE POLYCARBONATE MATERIAL, AND WITH MC53FL PRESSURE SENSITIVE ADHESIVE OR APPROVAL EQUAL. THIS SHALL BE INCIDENTAL TO PROJECT.

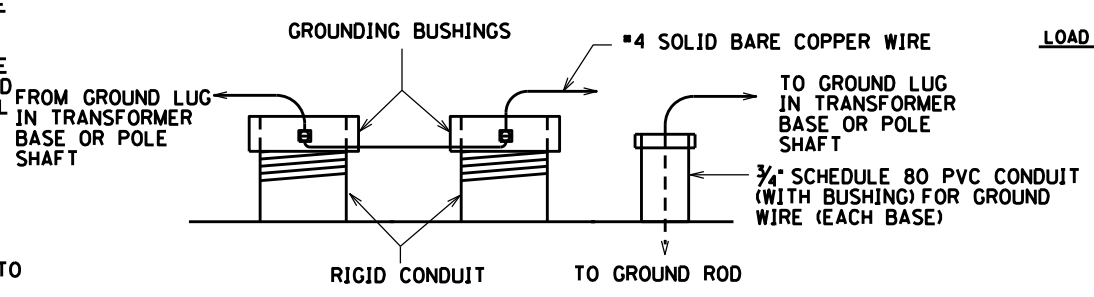

**TYPICAL GROUNDING DETAIL**

**GROUNDING REQUIREMENTS:**



CONTRACTOR SHALL PROVIDE A MINIMUM OF 6 INCHES OF GROUND WIRE FOR TESTING PRIOR TO CONNECTING THE WIRE TO TRANSFORMER BASE.

POLE/TRANSFORMER BASE GROUND - GROUND WIRE SHALL COME FROM THE GROUND ROD THROUGH THE PVC CONDUIT, CONNECTING TO THE TRANSFORMER BASE/POLE AND THEN TO EACH RIGID STEEL GROUNDING BUSHING.

**NOTES:**

ALL CONDUITS USED FOR THE GROUNDING, SPARES AND CONDUCTORS THAT ARE INSTALLED IN THE POLE BASE ARE INCIDENTAL TO BID ITEM "4740". THIS INCLUDES PROVIDING A MINIMUM OF 24 INCHES OF CONDUIT PAST THE EDGE OF THE POLE BASE.

NOTE: PRECAST CONCRETE BASES ARE NOT ACCEPTABLE

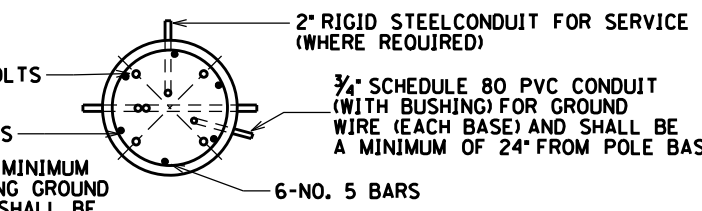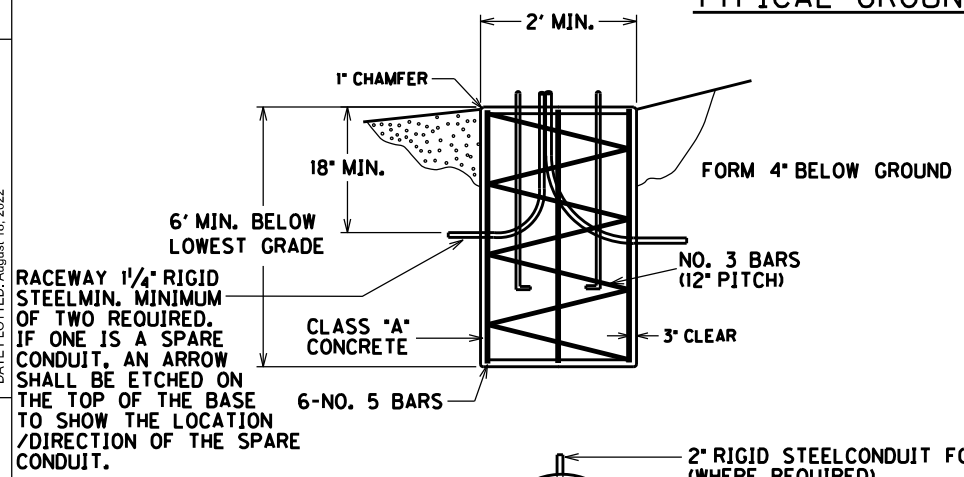

**FOUNDATION DETAIL**

ALL POLE BASES SHALL HAVE A MINIMUM OF TWO CONDUITS (NOT INCLUDING GROUND CONDUIT). THE SPARE CONDUIT SHALL BE 180 DEGREE FROM THE CONDUIT FOR THE CONDUCTORS.

FILE NAME: C:\P\WORK\TIED.SWANSEGAR\DN\28756105-TFORMER BASE (CL) SIGNAL.DGN

USER: ted.swansegar  
DATE PLOTTED: August 18, 2022

E-SHEET NAME:

Power InRoads v8.11.0.397